


$\Delta P$   
 Timer  
 Manual back-flush  
 40-60 sec. max.  
 1. filter back-flush    2. filter back-flush  
 Filtration

- 01 -Energized
- 00 -De-energized
- SL1 -Normally open. 24V D.C.  
3/8" solenoid valve (N.O)
- SL2 -Normally close 24V D.C.  
3/8" solenoid valve (N.C)
- SL3 -Normally open. 24V D.C.  
3/8" solenoid valve (N.O)
- SL4 -Normally close 24V D.C.  
3/8" solenoid valve (N.C)

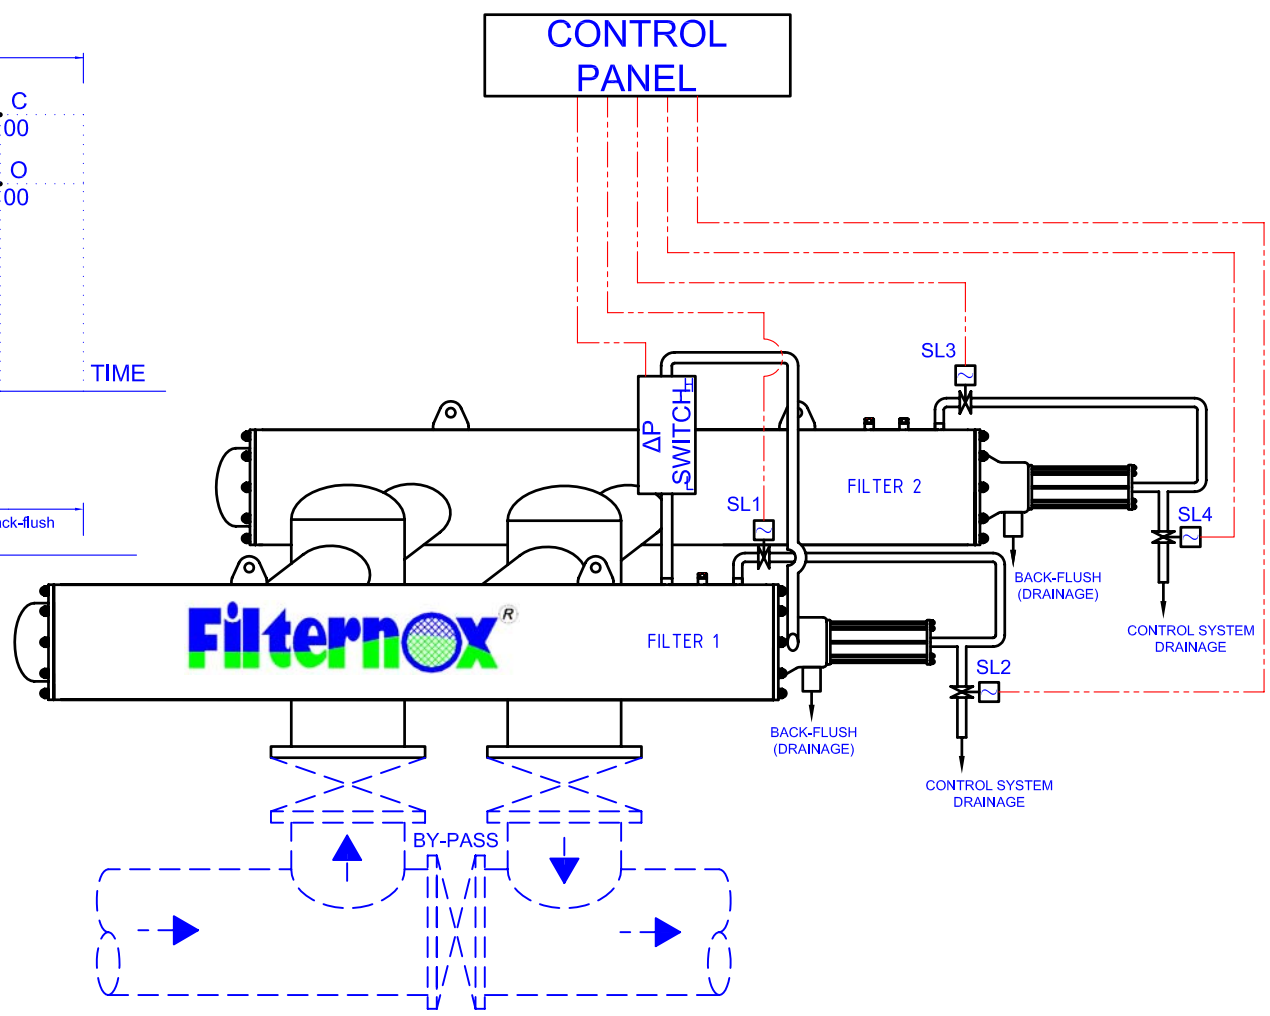

TYPICAL INSTALLATION AND ELECTRIC CONTROL SYSTEM CONNECTION DIAGRAM	
 AUTOMATIC SELF-CLEANING FILTER	<b>MODEL:</b> <b>TWIN</b>